

A Comparison of Three Different Reserve Margin Methods in the Context of an Island System

Energy Systems Integration Group 2024
Spring Technical Workshop

Tucson, Arizona

March 26, 2024



Energy+Environmental Economics

Arne Olson, Senior Partner



Agenda

- + Introduction to Hawaiian Electric Resource Adequacy Workplan Project
- + Methods for Evaluating Resource Adequacy
- + Testing three different methods for evaluating resource adequacy on O‘ahu
- + Results

Introduction to Hawaiian Electric Resource Adequacy Workplan Project



Energy+Environmental Economics

Study Footprint




Not considered in RA Workplan

Hawaiian Electric Footprint

Hawai'i PUC directed Hawaiian Electric to explore an ELCC-based resource adequacy framework

- + In the long-term, solar, wind, and storage resources will displace diesel generators in meeting O'ahu's resource adequacy needs, creating new reliability challenges
- + In 2022, the Commission instructed Hawaiian Electric to explore an ELCC-based resource adequacy criterion for use in future rounds of its Integrated Grid Plan (IGP)
- + In coordination with a Technical Advisory Panel (TAP), HECO + E3 explored three methods for incorporating RA need into capacity expansion modeling:
 - ERM+HDC
 - ERM+HEC
 - PRM+ELCC

2029 vs 2050 Annual Generation on O'ahu
GWh

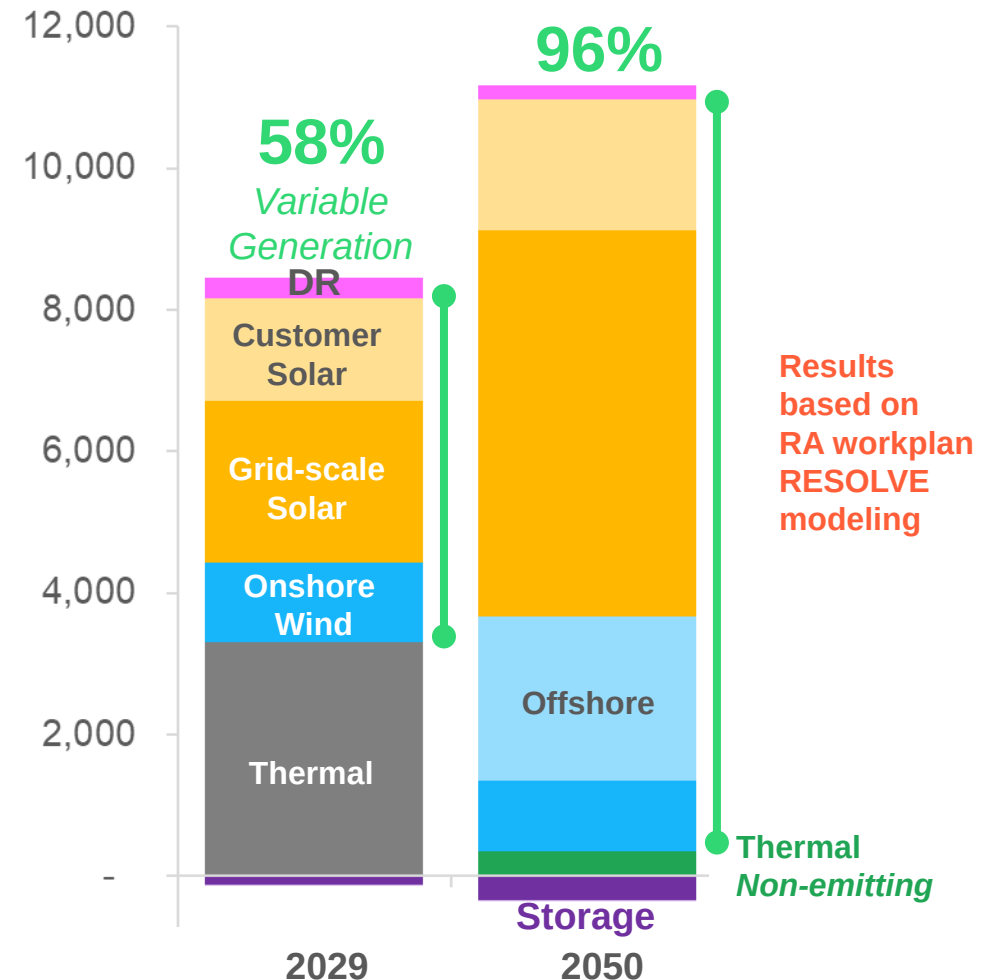

Technical Advisory Panel provided invaluable feedback to E3 and Hawaiian Electric

Name	Affiliation
Matthias Fripp	Environmental Defense Fund (EDF)
Aidan Tuohy	Electric Power Research Institute (EPRI)
Jo Ann Rañola	Electric Power Research Institute (EPRI)
Durgesh Manjure	Midcontinent Independent System Operator (MISO)
Jordan Bakke	Midcontinent Independent System Operator (MISO)
Andy Hoke	National Renewable Energy Laboratory (NREL)
Elaine Hale	National Renewable Energy Laboratory (NREL)
Gord Stephen	National Renewable Energy Laboratory (NREL)
Derek Stenclik	Telos Energy Group
Richard E. Rocheleau	Hawaii Natural Energy Institute (HNEI)
Terry Surles	Hawaii Natural Energy Institute (HNEI)




Today, reliability events occur during early evening, under high load and thermal plant outage conditions


2023 System: Constrained Summer Week

Simulated Weather: Jul 8-14th, 1987

MW

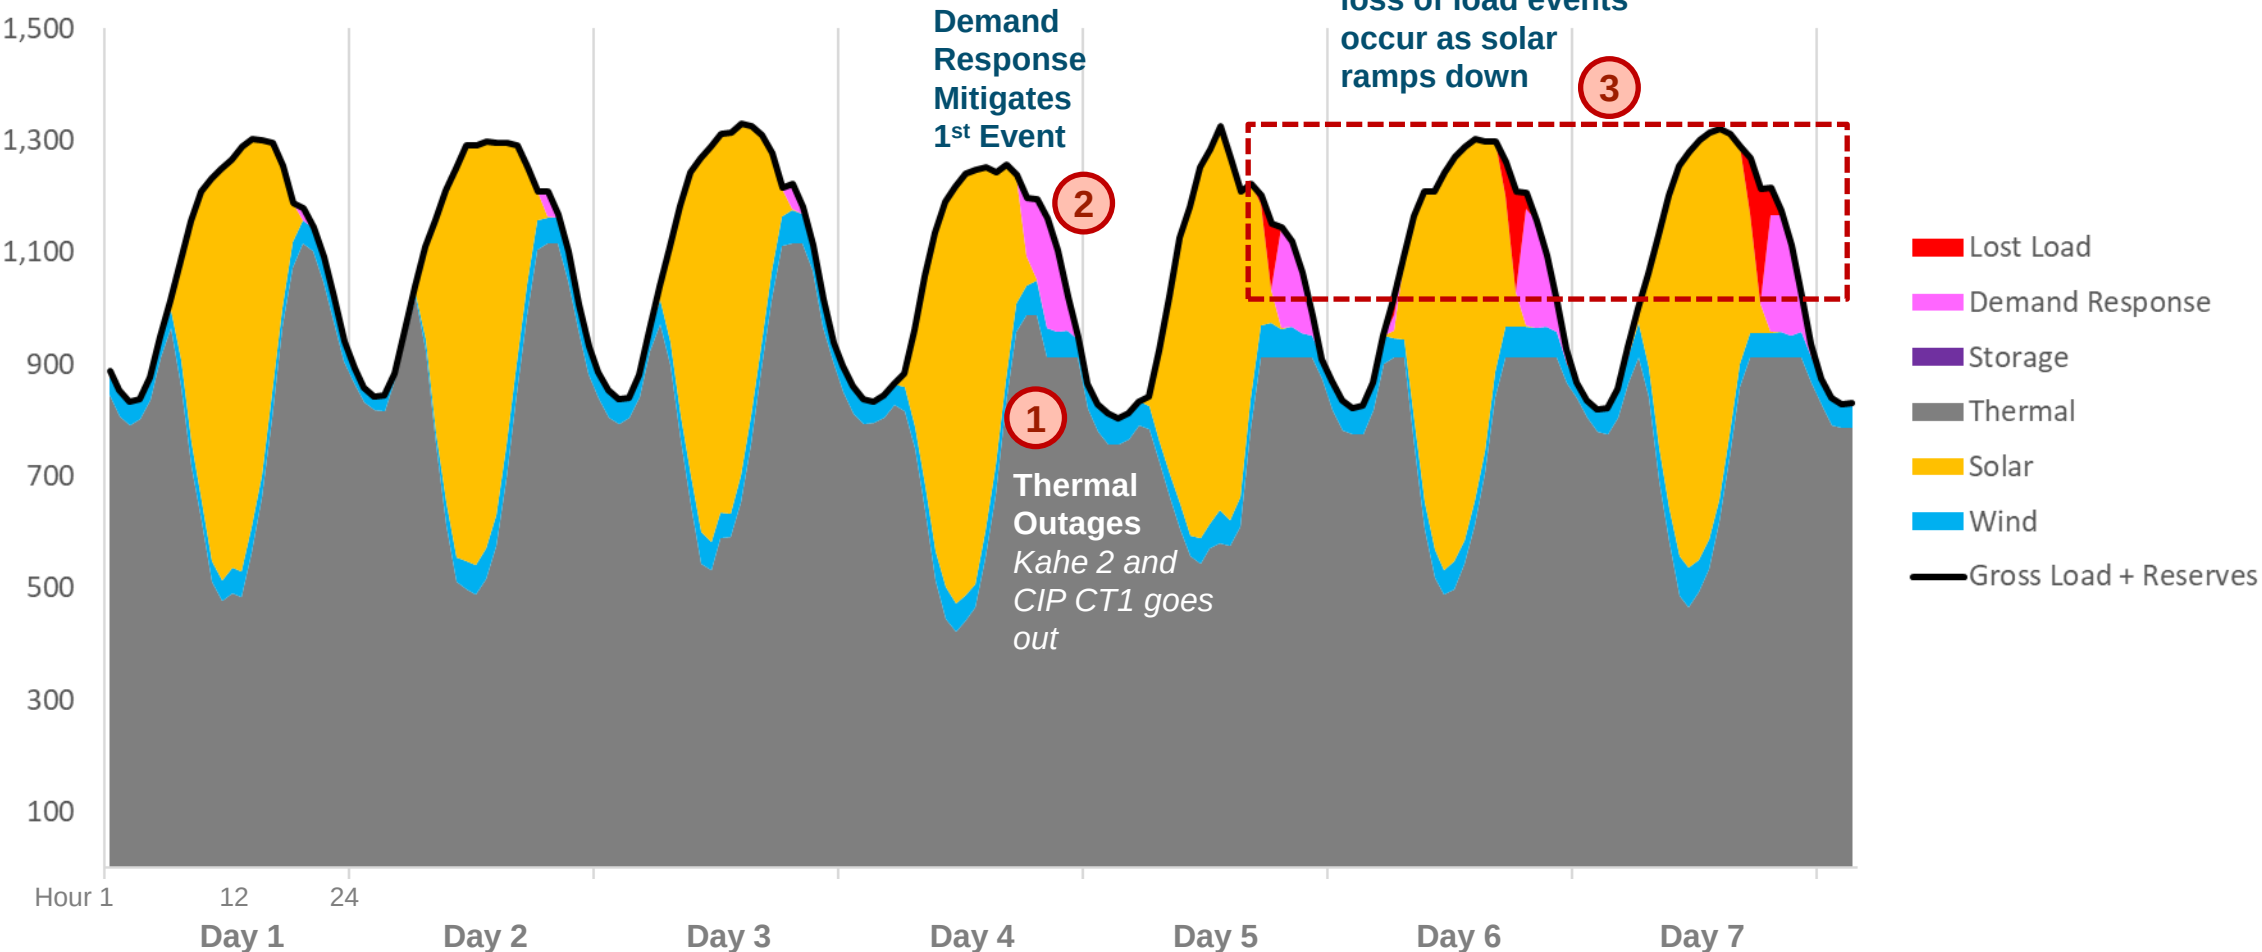

In 2050, a high renewable system without firm capacity has insufficient energy available during low renewable periods

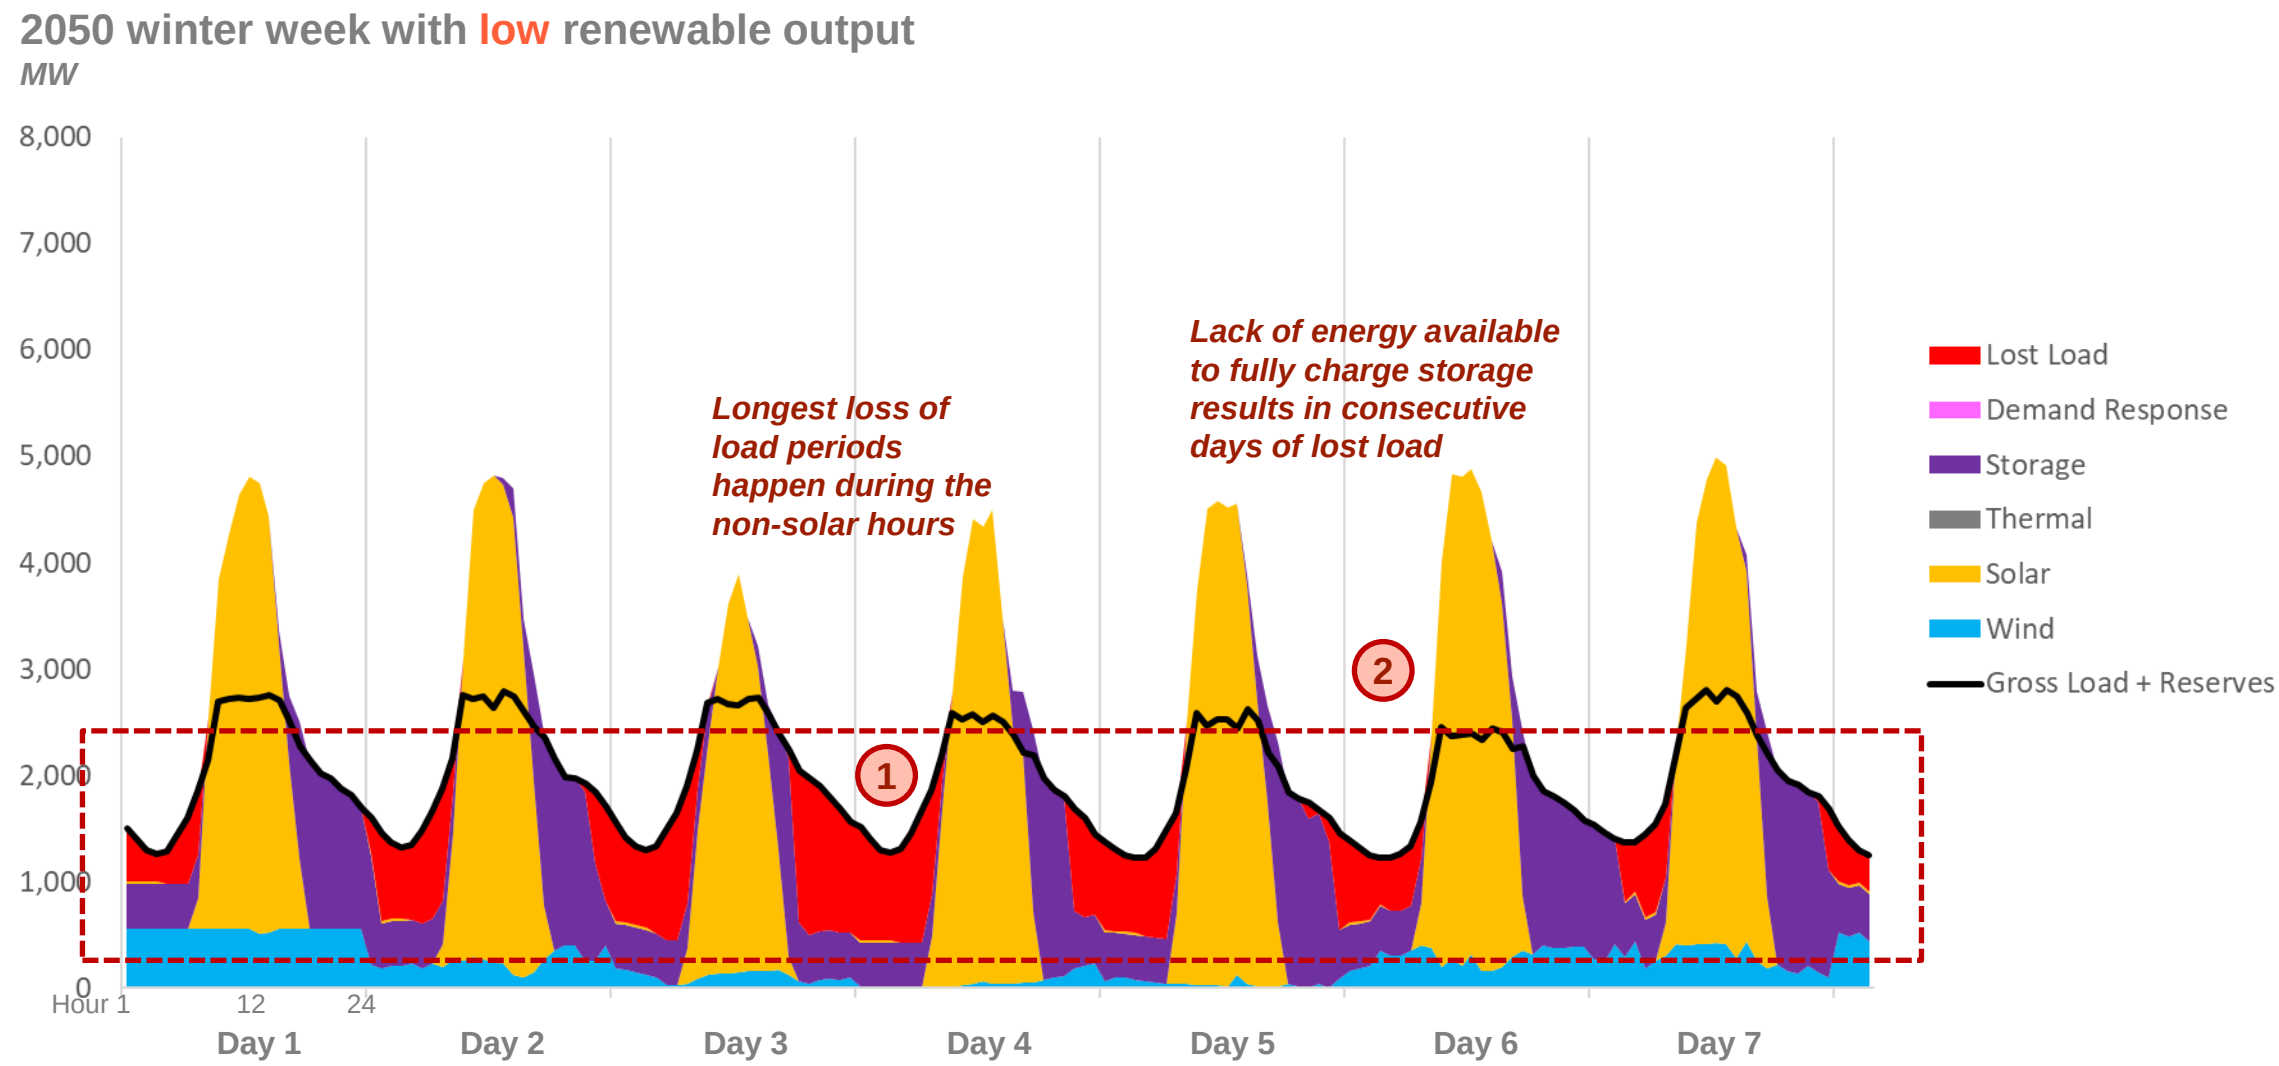

Methods for Evaluating Resource Adequacy



Energy+Environmental Economics

Total Resource Need (TRN) and Planning Reserve Margin (PRM) are the traditional metrics for resource adequacy need

- + Total Resource Need is the quantity of effective capacity needed to meet a defined reliability standard


- Typically defined as “1 day in 10 years” or 0.1 LOLE but other definitions may be useful

- + PRM is measured as the quantity of capacity needed above the median year peak load to meet the LOLE standard

- Calculated as $(\text{TRN} - \text{Median Peak}) / \text{Median Peak}$
 - Serves as a simple and intuitive metric that can be utilized broadly in power system planning



- Considers load and resource conditions during all hours of the year

Traditional Reliability Planning Process

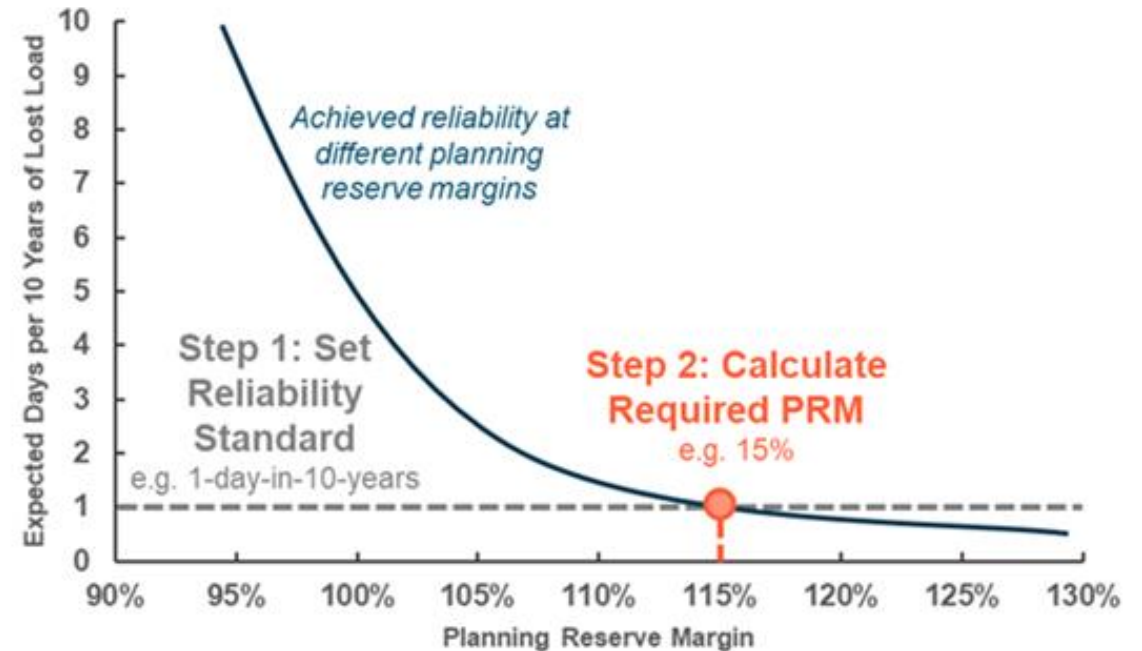


Interactive effect: The capacity contribution of variable and dispatch-limited resources diminishes at higher penetrations

Diminishing Capacity Value of Solar

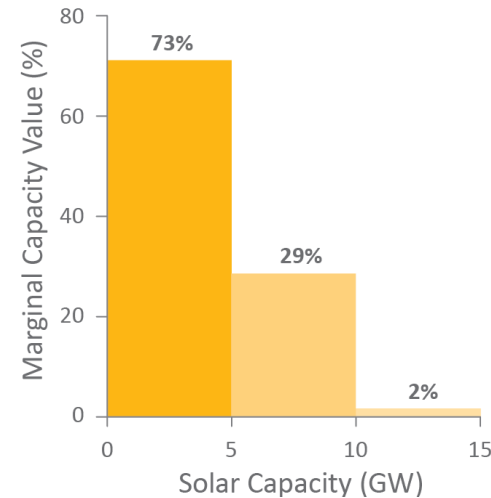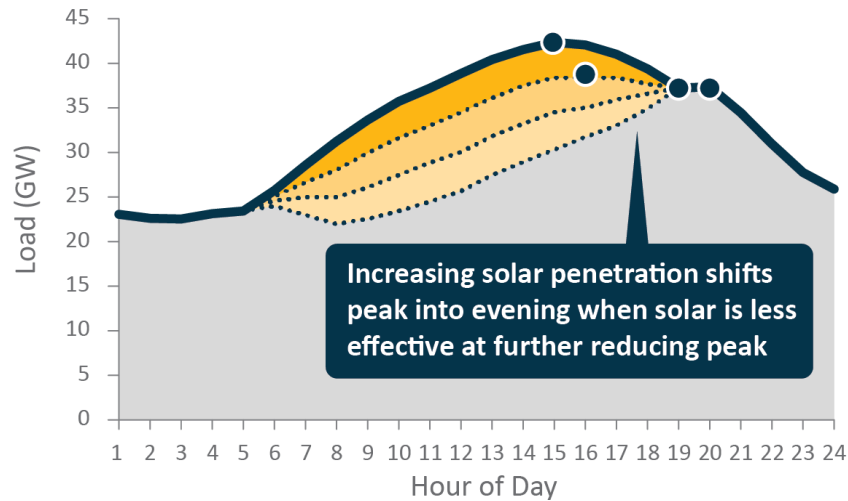

Solar and other variable resources (e.g. wind) exhibit declining value due to variability of production profiles


Diminishing Value of 4-hr Storage ELCC

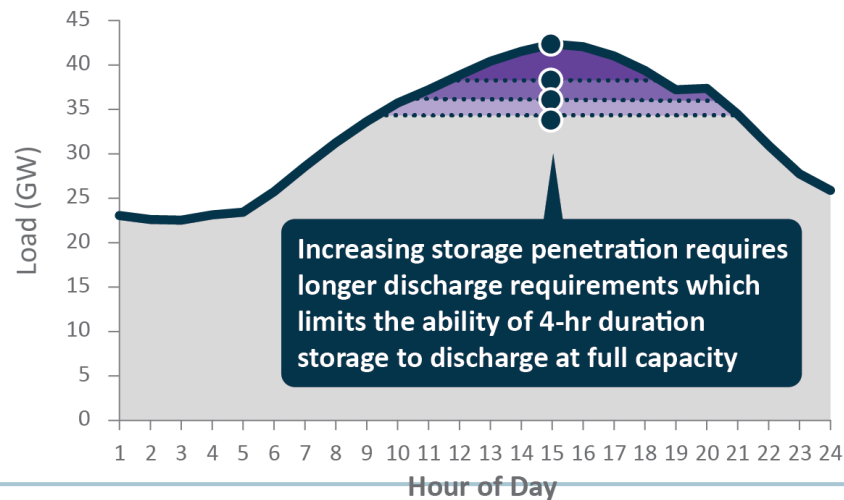

Storage and other energy-limited resources (e.g. DR, hydro) exhibit declining value due to limited ability to generate over sustained periods

Interactive effect: The capacity contribution of variable and dispatch-limited resources depends on the portfolio

- + Resources with complementary characteristics produce the opposite effect, synergistic interactions (also described as a “diversity benefit”)
- + As penetrations of intermittent and energy-limited resource grow, the magnitude of these interactive effects will increase and become non-negligible

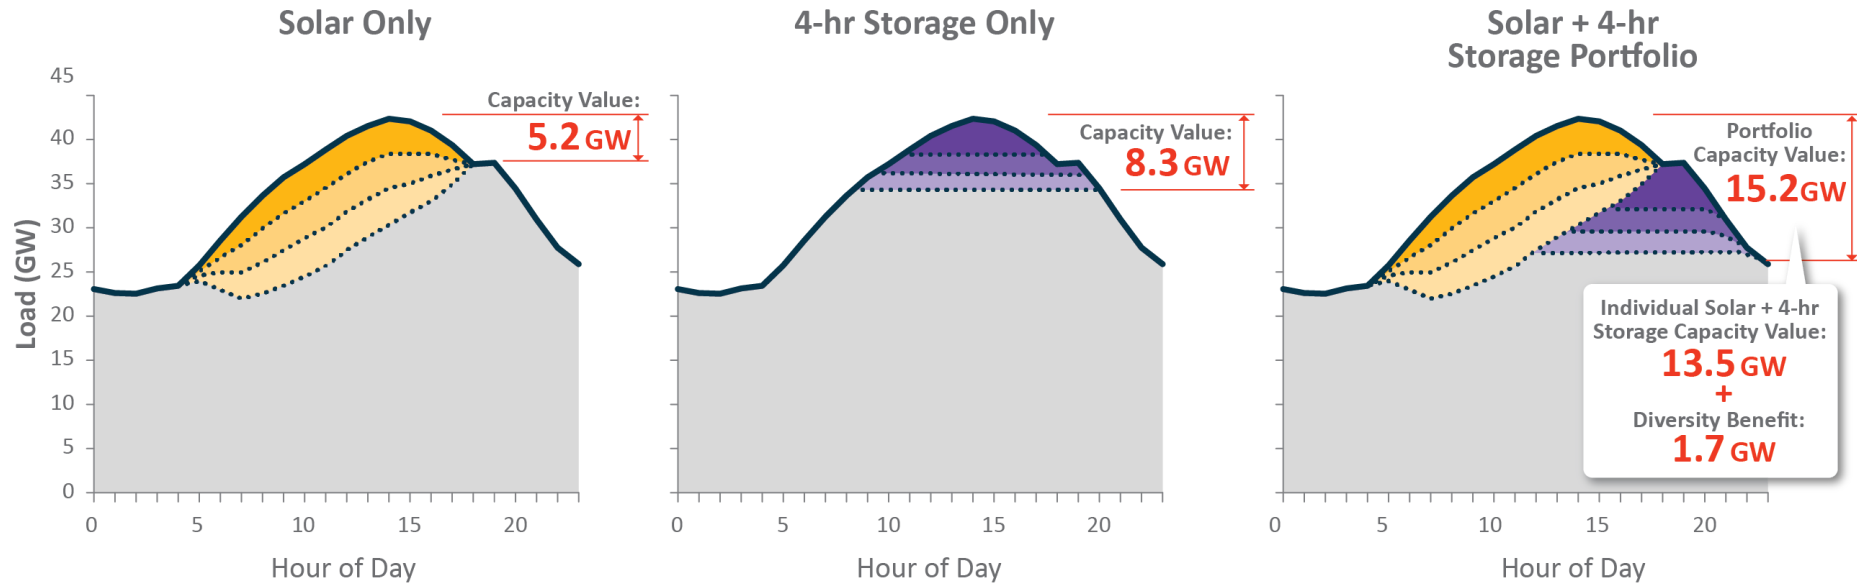

- + The existence of interactive effects means there is no mathematically unique way to calculate an average ELCC for multiple resource types


Resource accreditation is simple in the traditional planning paradigm

+ PRM defined based on Installed Capacity method (ICAP)

- ❑ Covers annual peak load variation, operating reserve requirements, and thermal resource forced outages

+ Individual resources accredited based on nameplate capacity

- ❑ Small differences in forced outage rates
- ❑ No interactions among resources
- ❑ Forced outages also incorporated through performance penalties

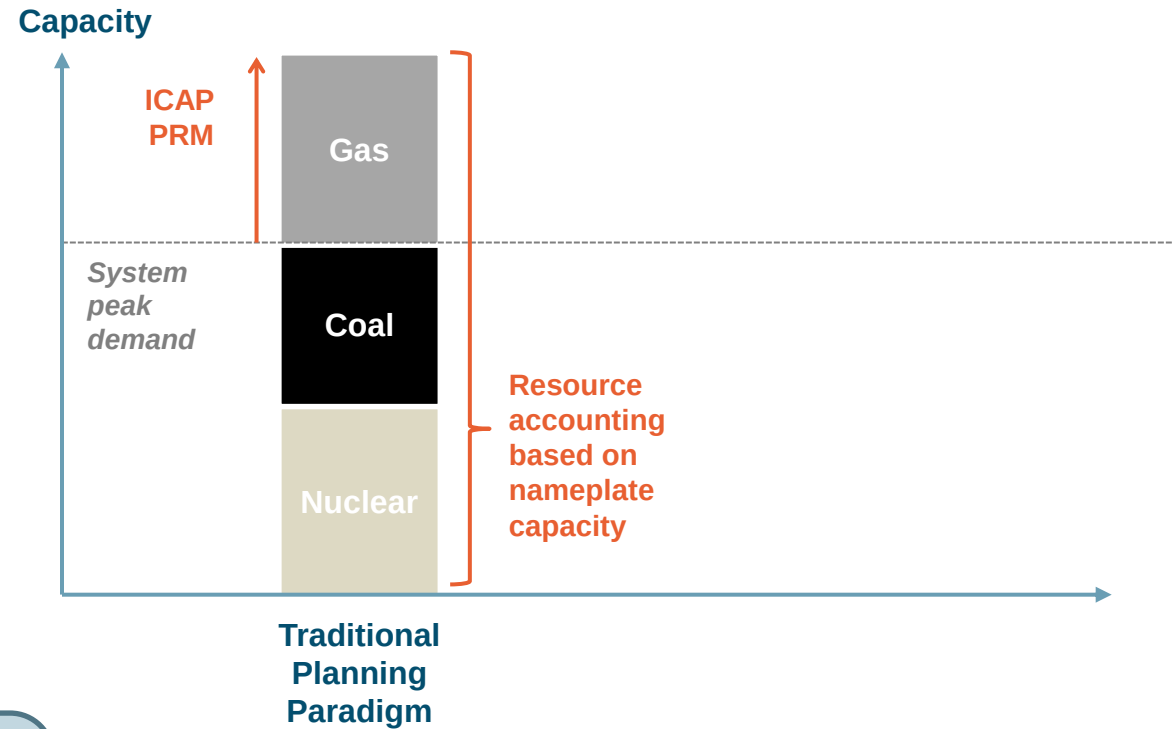

$$\text{Installed Capacity} = \sum_{i=1}^n G_i$$


Adapting the PRM framework for a more diverse resource mix

+ PRM defined based on need for Equivalent Perfect Capacity (PCAP)

- ❑ Covers annual peak load variation and operating reserves only; forced outages addressed in resource accreditation

+ Individual resources accredited based on ELCC

- ❑ Large differences in availability during key hours
- ❑ Significant interactions among resources
- ❑ ELCC values are dynamic based on resource portfolio

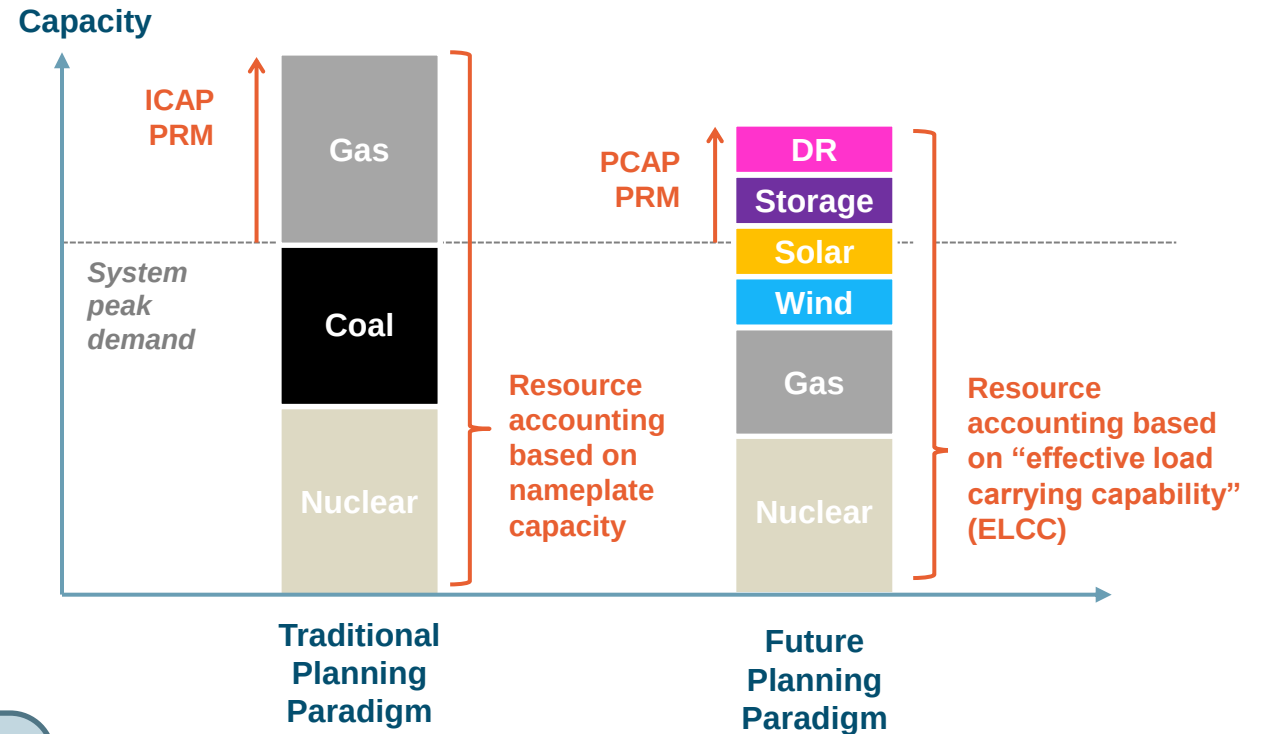

$$\text{Portfolio ELCC} = f(G_1, G_2, \dots, G_n)$$

Measuring ELCC of a portfolio and individual resources

+ ELCC is a function of the portfolio of resources

- ❑ The function is a surface in multiple dimensions
- ❑ The Portfolio ELCC is the height of the surface at the point representing the total portfolio


$$\text{Portfolio ELCC} = f(G_1, G_2, \dots, G_n) \text{ (MW)}$$

- ❑ The Marginal ELCC of any individual resource is the gradient (or slope) of the surface along a single dimension – mathematically, the partial derivative of the surface with respect to that resource

$$\text{Marginal ELCC}_{G_1} = \frac{\partial f}{\partial G_1} (G_1, G_2, \dots, G_n) \text{ (\%)}$$

+ The functional form of the surface is unknowable

- ❑ Marginal ELCC calculations give us measurements of the contours of the surface at specific points
- ❑ It is impractical to map out the entire surface

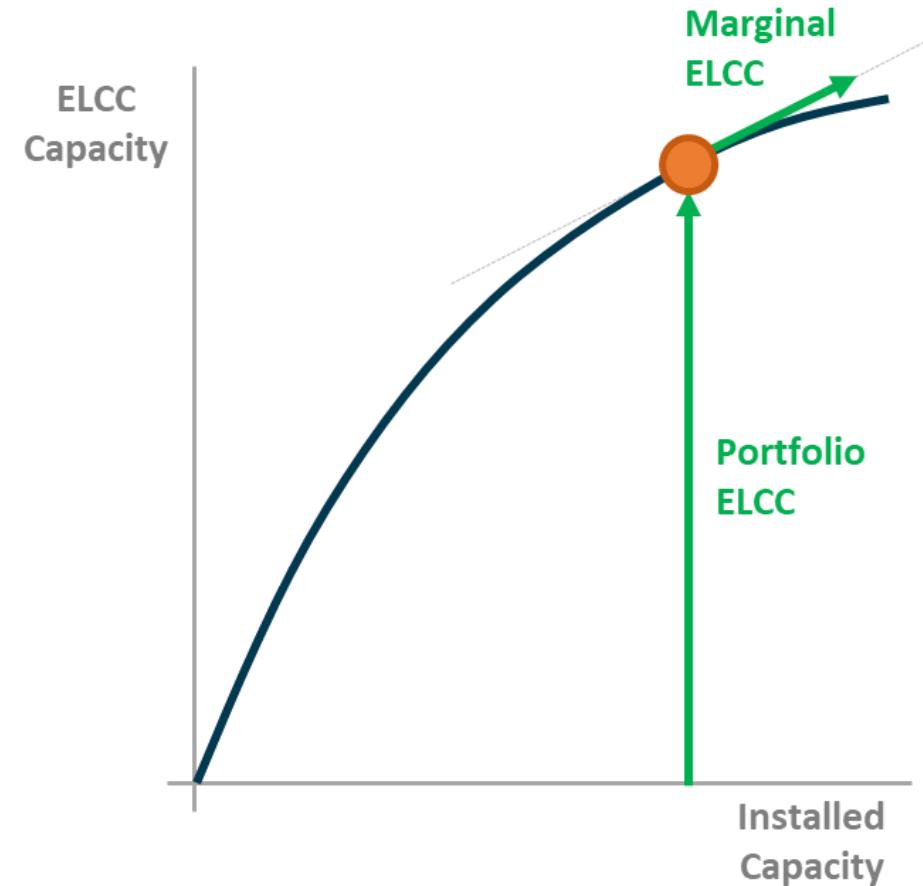

Testing three different methods for evaluating resource adequacy on O‘ahu




Hourly Energy Reserve Margin + Hourly Dependable Capacity

- + ERM+HDC is an hourly resource availability and load accounting methodology used by HECO
- + For variable resources (e.g. renewables), Hourly Dependable Capacity (HDC) method uses historical / simulated hourly data from multiple years and determines the “1-in-5 worst output in each hour”
 - Both load and resources inputs based on statistics and does not capture historical correlations between solar, wind, and load


Hourly ERM Requirement on June 4th, 2015

MWs

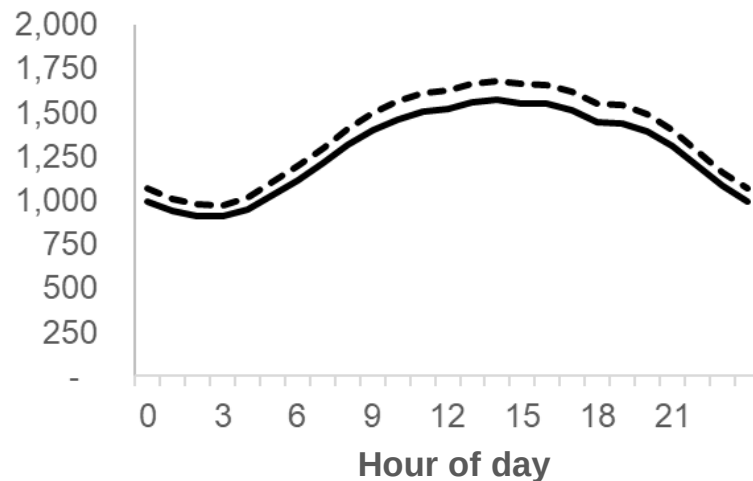


Hourly Solar Production on June 4th

2015-2019 Historical Output
% of Nameplate

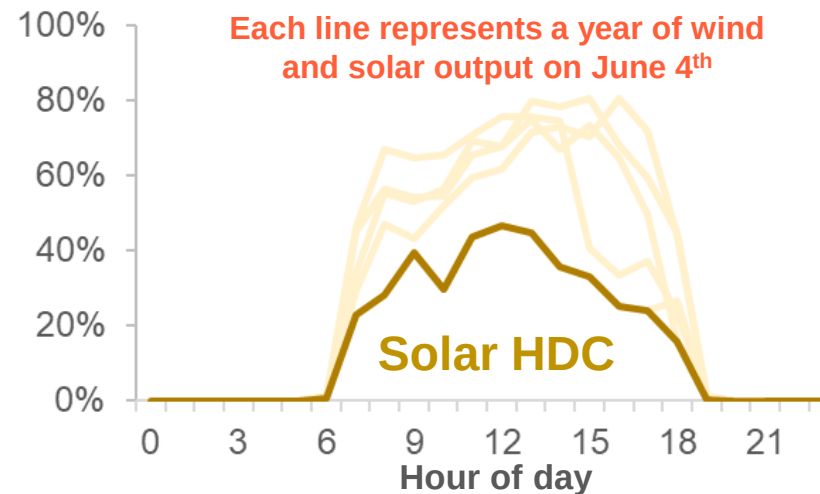

Hourly Wind Production on June 4th

2015-2019 Historical Output
% of Nameplate

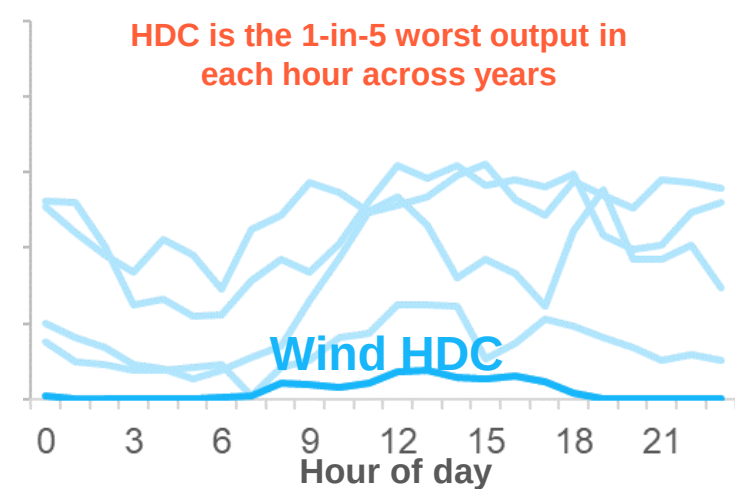

Hourly ERM + Hourly Expected Capacity for Solar and Wind

+ ERM+HEC is an hourly resource availability and load accounting methodology

- Hourly Expected Capacity (HEC) is an adaptation of HDC that E3 and Hawaiian Electric developed with the TAP


+ Hourly Expected Capacity (HEC) uses the same historical and simulated variable hourly profiles as HDC, but uses all the years directly as the resource accreditation in capacity expansion

- Instead of using an exceedances or averages, actual/simulated hourly production is used
- Captures both high output and renewable drought periods

Summer day with **high renewable output**,

June 1, 2015


% of nameplate

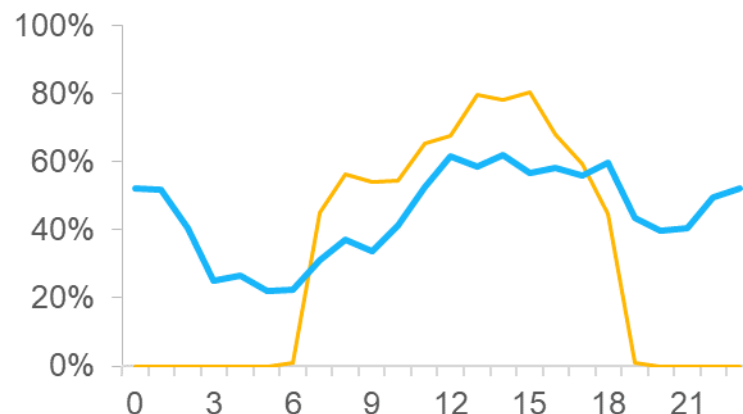

Winter day with **low renewable output**,

Jan 15, 2015


% of nameplate

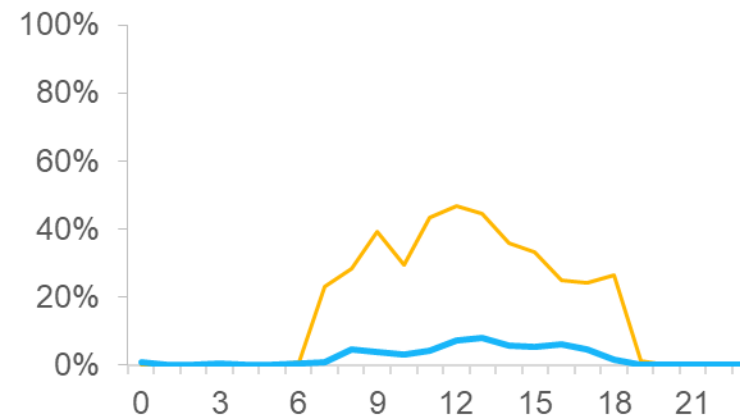

Planning Reserve Margin + Effective Load Carrying Capability


- + PCAP PRM+ELCC is an annual resource availability and load accounting methodology increasingly used on the mainland
- + “ELCC for All” approach provides a simple and robust framework for resource adequacy accounting
- + ELCC can account for all factors that can limit availability:
 - Hourly variability in output
 - Duration and/or use limitations
 - Seasonal temperature derates
 - Temperature-related outage rates
 - Forced outages
 - Energy availability
 - Fuel availability
 - Correlated outage risk, *especially under extreme conditions*

Illustrative ELCC Values Across Technologies

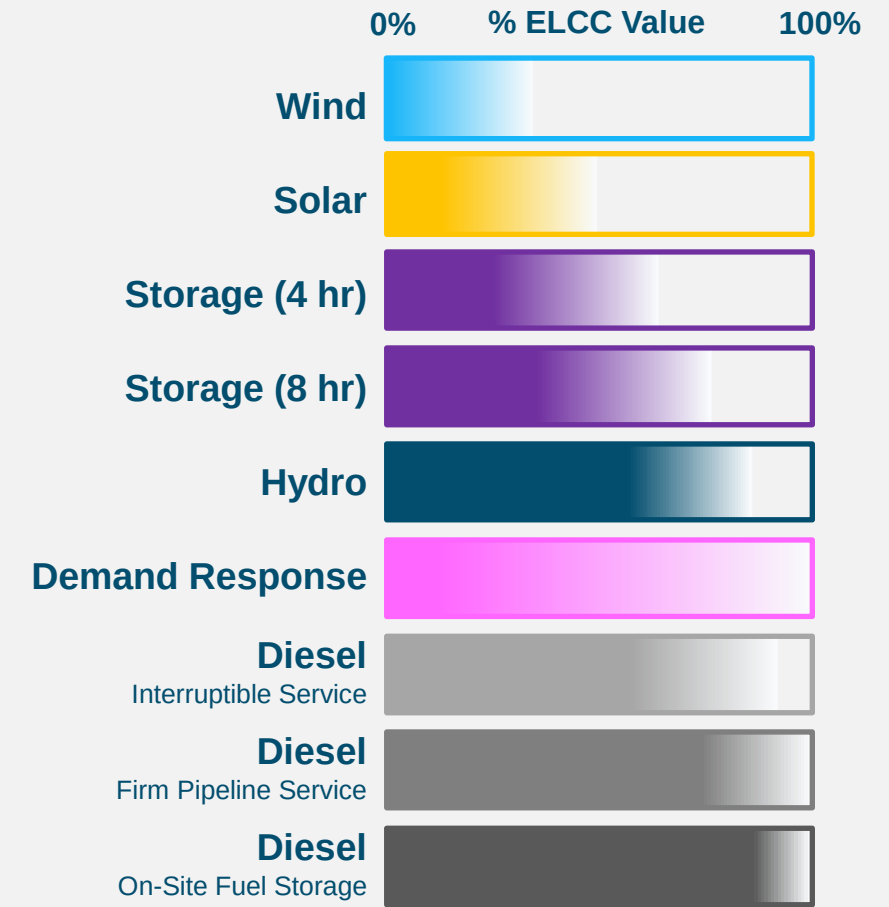


Building an ELCC surface in one dimension for use in Long-Term Capacity Expansion Model

Calculate ELCC at Different Levels of Penetration

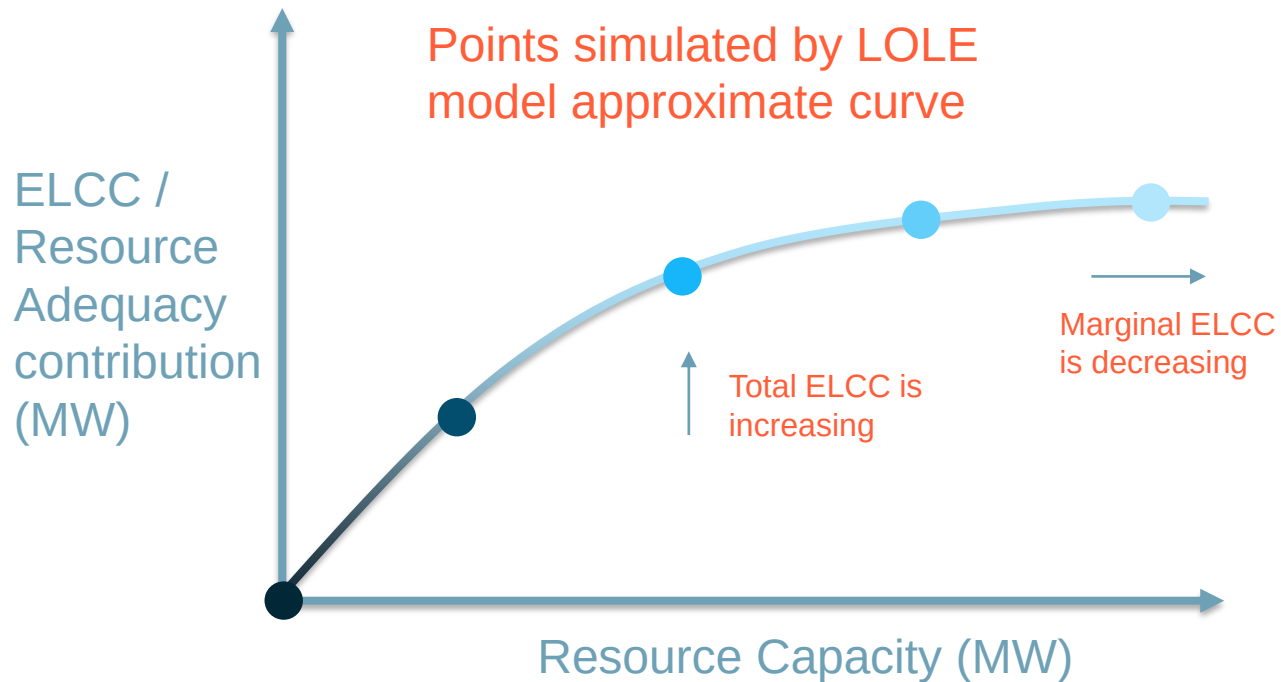

Linear equations to approximate ELCC curve

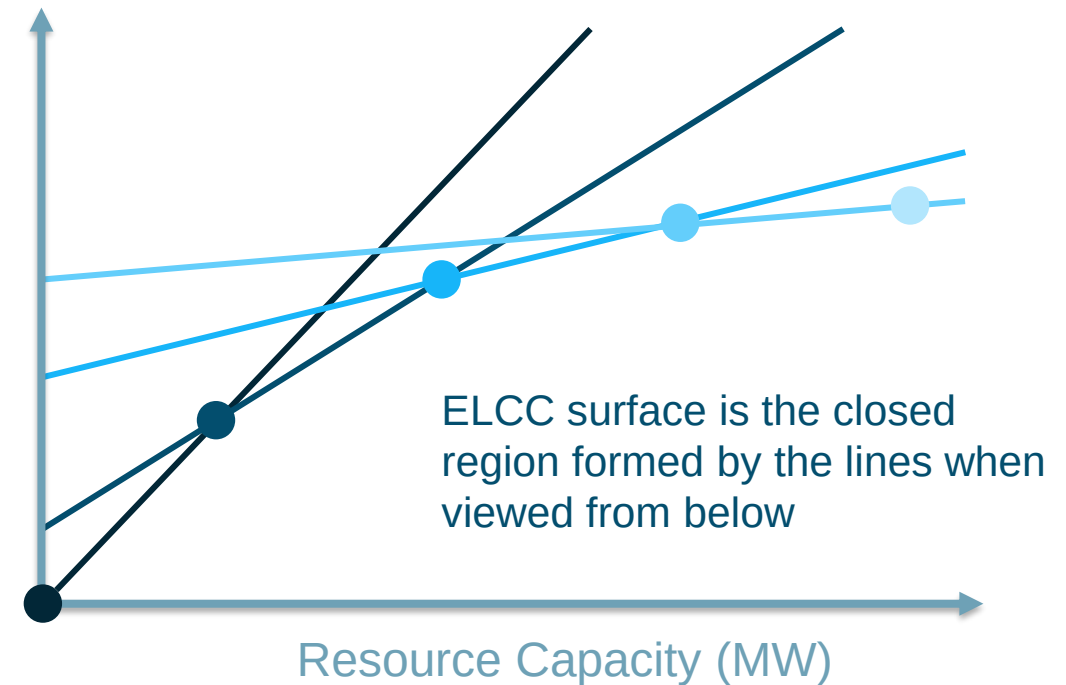

Implementing in capacity expansion model

All equations implemented in capacity expansion linear optimization simultaneously

>> Only one will be binding each year

$$\text{ELCC} \leq 1 * \text{ResCap} + 0$$


Example values

$$\text{ELCC} \leq 0.7 * \text{ResCap} + 80$$

$$\text{ELCC} \leq 0.3 * \text{ResCap} + 200$$

$$\text{ELCC} \leq 0.1 * \text{ResCap} + 300$$

ELCC /
Resource
Adequacy
contribution
(MW)

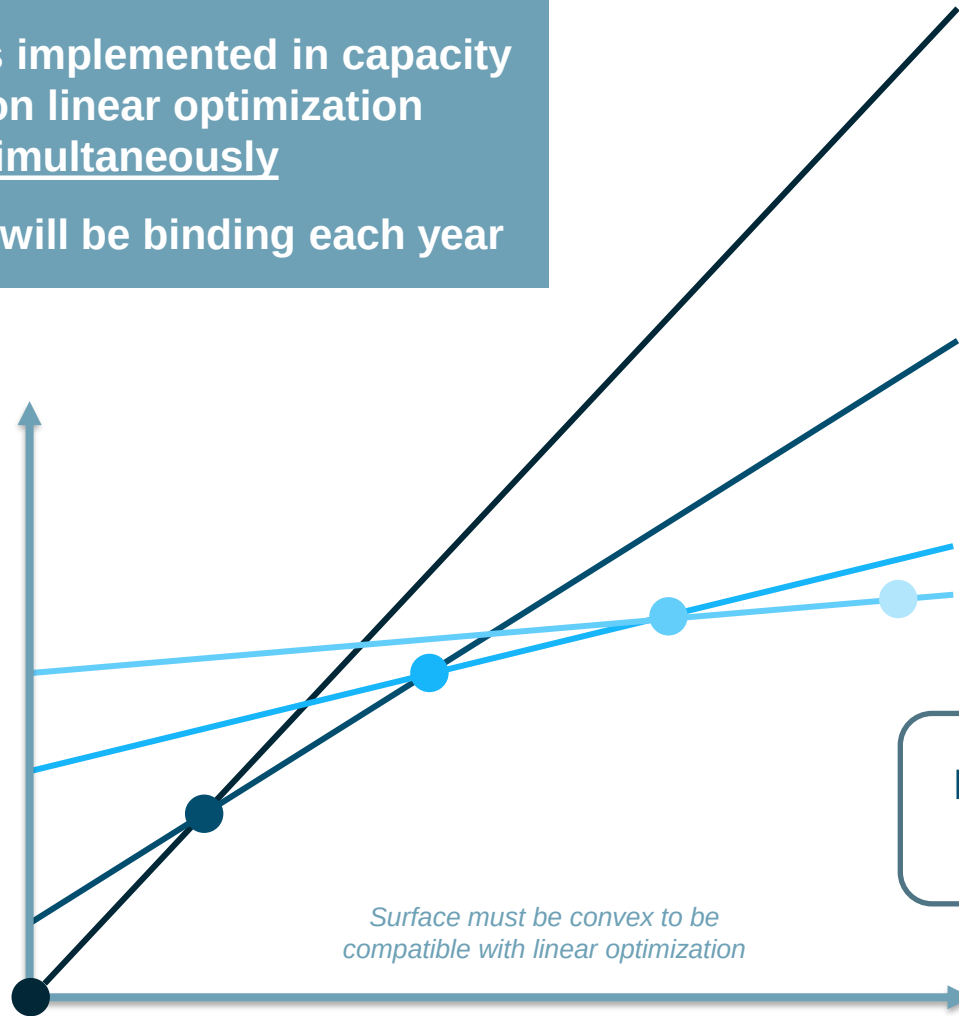


Surface must be convex to be compatible with linear optimization

$$\text{Portfolio ELCC} \leq \text{Incremental Capacity Value} * \text{Resource Capacity} + \text{Line Intercept}$$

General form of equation


Now in two dimensions....

- + E3 developed a two-dimensional ELCC surface representing the combined capacity contribution of different quantities of solar and battery storage

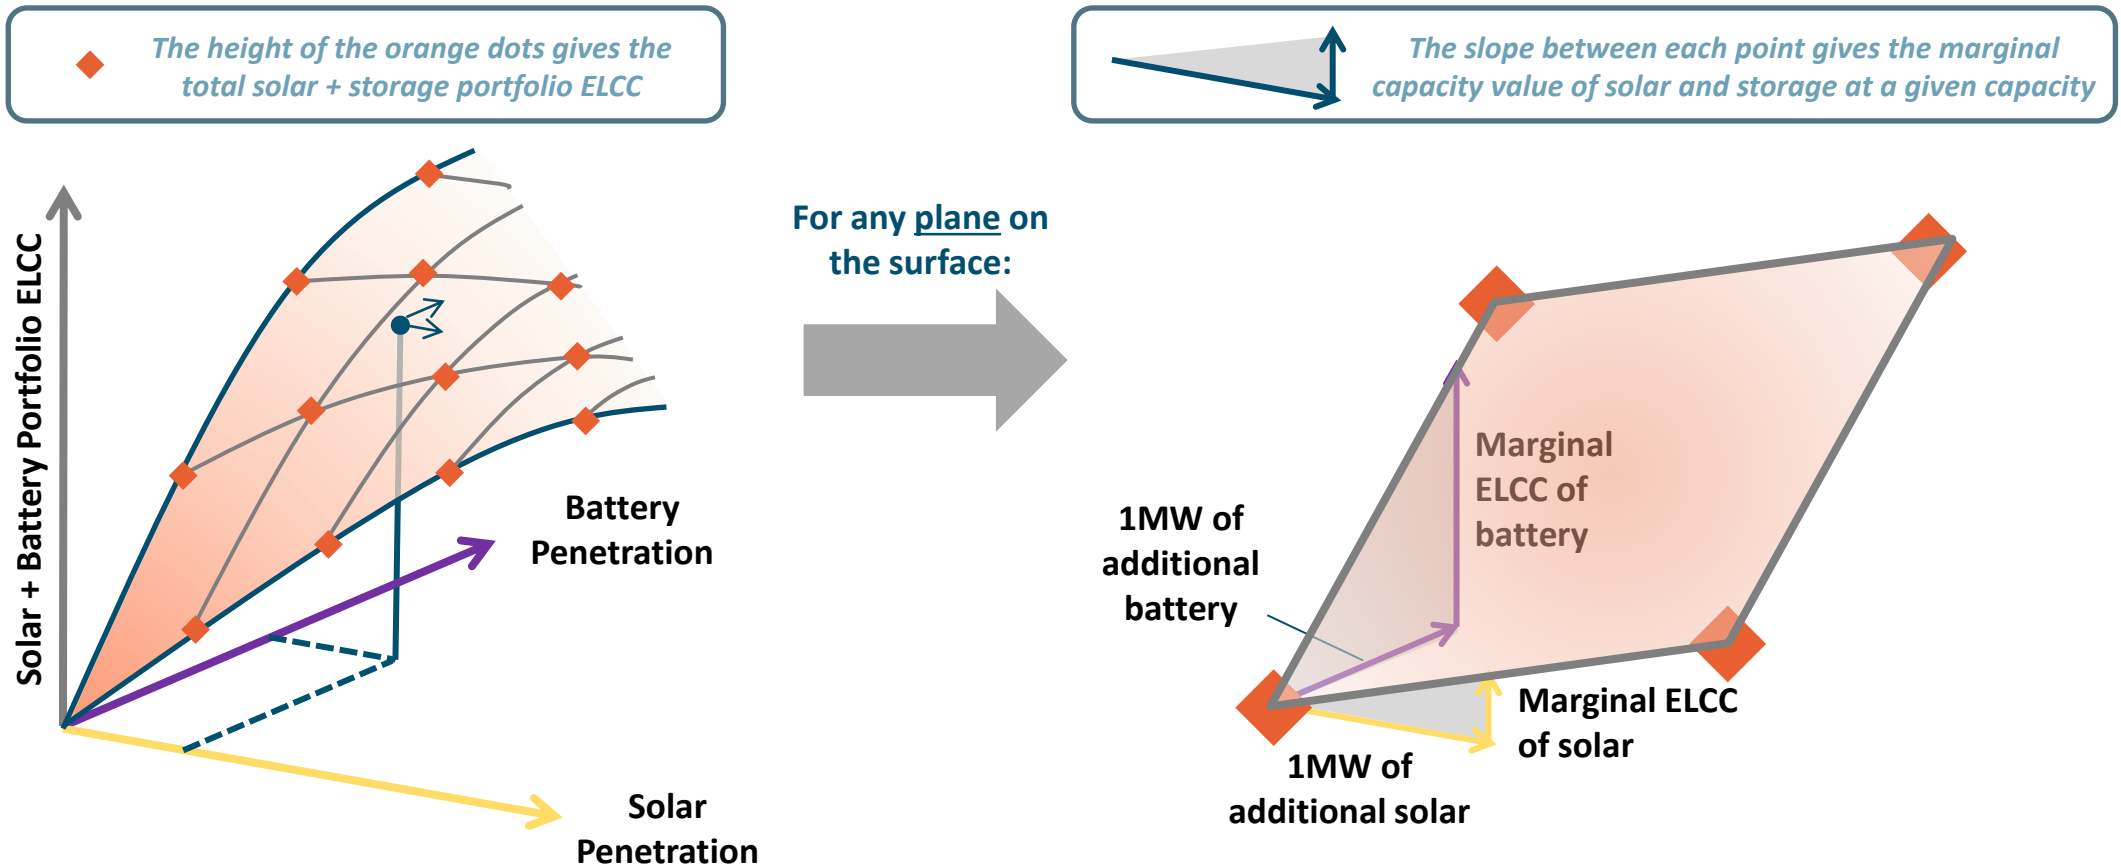

Portfolios developed under each framework are calibrated to common reliability standard using E3's RECAP Model

Portfolio calibration process for each RA framework to ensure each portfolio meets 0.1 LOLE

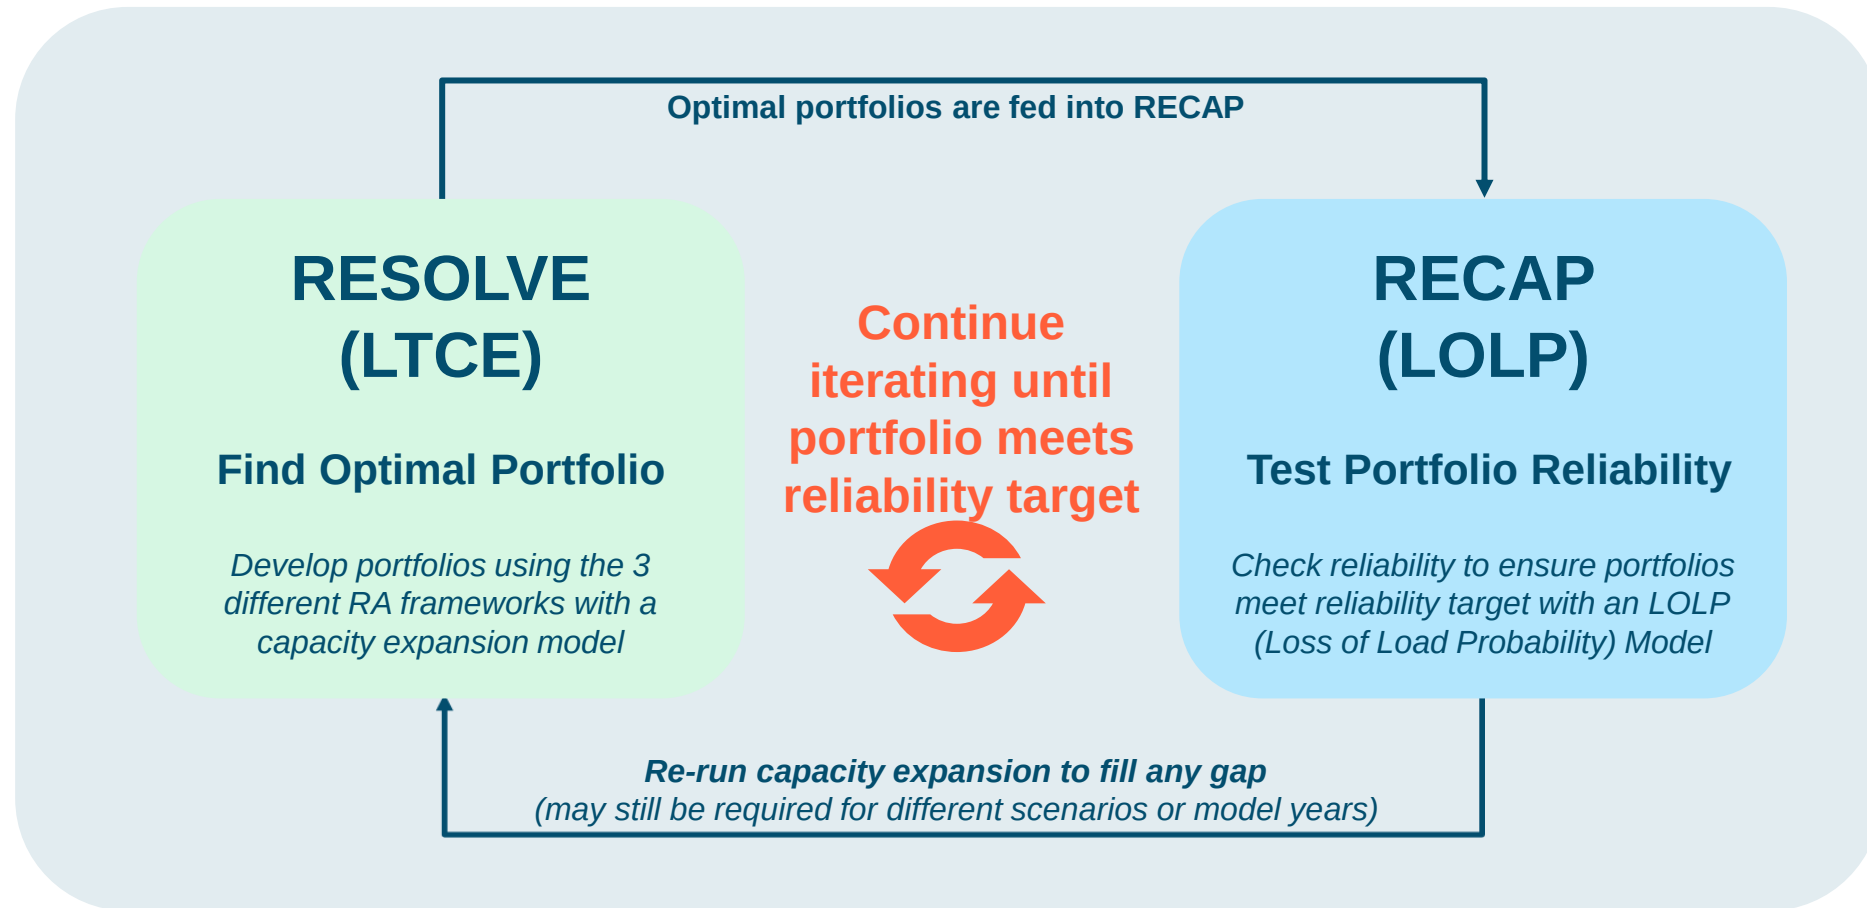


Results



Quantitatively, each RA framework achieves similar costs and reliability... but with varying levels of modeling challenges

2050 Total Installed Capacity, MW

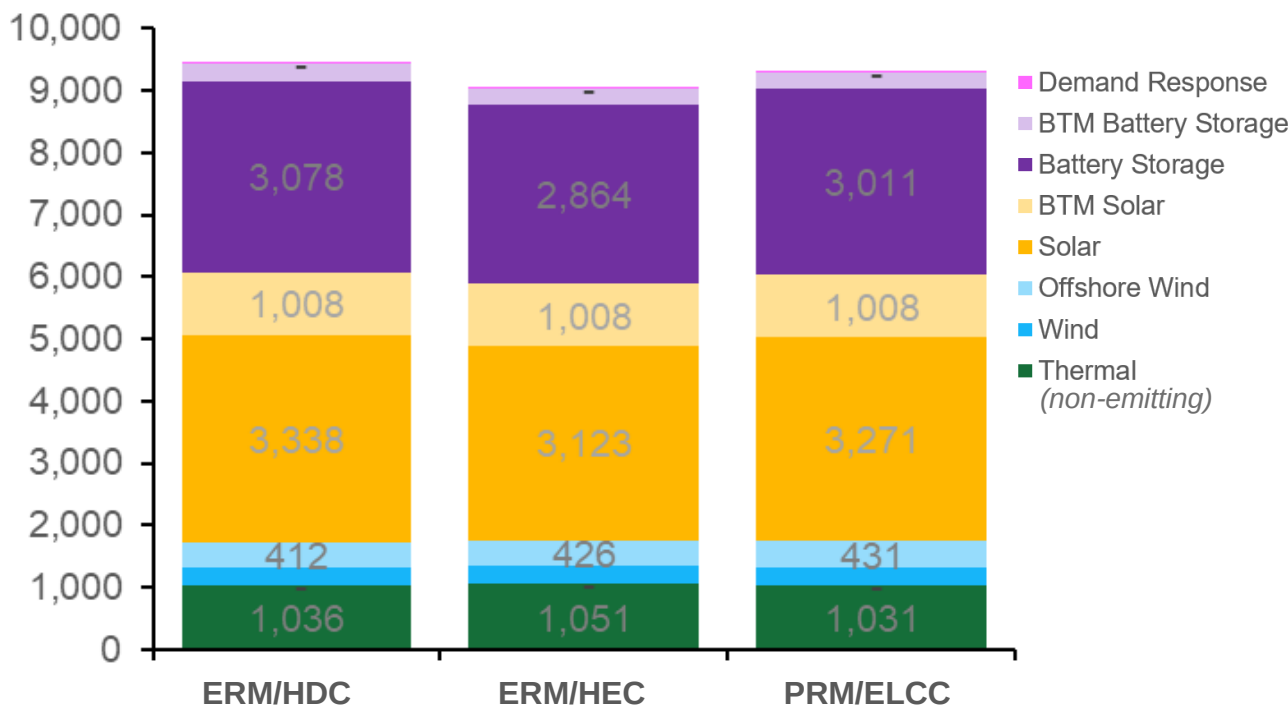

Total Storage Energy Capacity	9,007 MWh	8,490 MWh	8,876 MWh
-------------------------------	-----------	-----------	-----------

Result	Units	HDC	HEC	ELCC
GHG Emissions	MMT	0	0	0
Loss of Load Expectation	days/year	0.1	0.1	0.1
Reserve Margin	% above load	10% Above Hourly	-2% Above Hourly	16% Above Annual Peak
Modeled Cost	\$Mil	812	811	806
Expected Unserved Energy	MWh or NEUE	239	247	214
Iterations	Model Runs	1	8	2

Because portfolios results are similar, differences in qualitative goals will help decide the appropriate framework for HECO

Evaluating each framework

+ To achieve workplan goals as described by the commission’s order, E3 and Hawaiian Electric borrowed from ESIG’s recent paper *Ensuring Efficient Reliability: New Design Principles for Capacity Accreditation*

If quantitative evaluations all similar, differences in qualitative goals will help decide the appropriate framework for HECO

Non-Discriminatory	Transparent	Complexity*	Predictable	Qualitative Metrics
Accreditation is applied to all resources using a similar methodology.	Accreditation can be effectively communicated to stakeholders, and data are readily available for decision making.	Accreditation process does not create undue burden to grid planners and stakeholders	The process is repeatable and consistent. It does not yield volatile or unexplained changes year to year	

We should expect each framework to achieve these goals

Reliable	Least Cost*	Robust	Quantitative Metrics
Accreditation accurately measures performance during real scarcity events.	Accreditation sends the correct marginal investment signals to meet reliability at least cost	Accreditation continues to work as the resource mix, load patterns, and system risk change over time.	

*Least cost and complexity are additional criteria for this workplan

Qualitative Method Comparison Summary Matrix

	ERM + HDC	ERM + HEC	PRM + ELCC
Robustness 	2/5 - ERM depending on resource portfolio - Statistical representation masks real system dynamics	2/5 - ERM depending on resource portfolio - ERM volatility produces counterintuitive results	5/5 - PRM is dependent on load only - Stable PRM throughout modeling
Non-discriminatory 	1/5 - Different metrics for each resource - Historical statistics used	3/5 - Different metrics for each resource - Actual output used	5/5 - Same metric across resources - Historical statistics used
Transparent 	2/5 Clear approach but needs statistical representation, which hides information	2/5 - Clear approach - Simple representation in capacity expansion	2/5 “Black box” model - Results tied to resources’ contribution to reliability
Complexity 	3/5 - More iteration required - Relatively intuitive results metric	2/5 - More iteration required - Interpretation of results difficult - Could results in non-intuitive results metric	3/5 - Less iteration required - Results metrics industry standard
Predictability 	3/5 - Repeatable process - Less Volatile ERM results YoY	2/5 - Repeatable process - Risk of volatile ERM results YoY	5/5 - Repeatable process - Stable PRM - Stable ELCCs

E3 recommends the PRM/ELCC methodology for future IGPs

- + For PRM/ELCC's main benefit is its **fairness** across all types of resources (whether variable, use-limited, or firm) and its **predictability and stability** in marginal investment signal
- + Most utilities and capacity markets have moved or are moving to a PRM/ELCC-like framework for their long-term planning
- + This RA study showed that PRM/ELCC can capably address Hawai'i's unique carbon-free energy focused planning challenges
 - With other entities and markets using a PRM/ELCC framework, the growing body of knowledge and experience worldwide will only enhance and strengthen the way Hawaiian Electric plans for resource adequacy in its IGP process
- + Using an industry-standard resource adequacy approach also facilitates increased stakeholder engagement for those stakeholders engaged across multiple utility planning processes

Resource Adequacy Frameworks

ERM + HDC

*Energy Reserve Margin +
Hourly Dependable Capacity*

ERM + HEC

*Energy Reserve Margin +
Hourly Expected Capacity*

PRM + ELCC

*Planning Reserve Margin +
Effective Load Carrying
Capability*

Thank you!

Arne Olson, Senior Partner (arne@ethree.com)

Aaron Burdick, Director (aaron.burdick@ethree.com)

Adrian Au, Managing Consultant (adrian@ethree.com)



Energy+Environmental Economics